

EXPERIMENTAL INVESTIGATION OF TUBE SIDE HEAT TRANSFER ENHANCEMENT USING WIRE COIL INSERT

Sumana Biswas^{1,*} and Bodius Salam²

^{1,2}Department of Mechanical Engineering
Chittagong University of Engineering and Technology, Bangladesh

^{1,*}sbiswas@cuet.ac.bd, ²bsalam@cuet.ac.bd

Abstract- Enhancement of heat transfer by inserting different types of turbulators in to the tube is one of the conventional passive augmentation methods. An experimental investigation was carried for measuring tube-side heat transfer coefficient, friction factor, heat transfer enhancement efficiency of air for turbulent flow in a circular tube fitted with wire coil insert. A copper tube having 27 mm inside diameter, 30 mm outside diameter and of which length of 285 mm was used as the test section. A stainless steel coil was used as an insert where the wire diameter (e) was 2.8 mm and coil diameter (d) was 24 mm. In the experiment, the dimensionless pitch (p/d_i) was considered 0.708 and the dimensionless wire diameter (e/d_i) was considered 0.112. A uniform heat flux condition was created by wrapping Nichrome wire around the test section and fiber glass over the wire. Outer surface temperatures of the tube were measured at 6 different points of the test section by K-type thermocouples. Two thermometers were used for measuring the bulk temperatures. Reynolds numbers were varied from 8317 to 17821 in the experiment with heat flux variation from 271 to 610 W/m² for smooth tube, and 284 to 929 W/m² for tube with insert. Nusselt numbers obtained from smooth tube were compared with Gnielinski [1] correlation and errors were found to be in the range of $\pm 20\%$ with r.m.s. value of 16.5%. At comparable Reynolds number, Nusselt numbers in tube with wire coil insert were enhanced by 1.47 to 2.33 times at the cost of increase of friction factors by 3 to 3.5 times compared to that of smooth tube. Heat transfer enhancement efficiencies were found to be in the range of 1.3 to 2.6 and increased with the increase of Reynolds number.

Keywords: Heat transfer enhancement, Wire coil insert, Heat flux, Nusselt number.

1. INTRODUCTION

Heat transfer enhancement provides a simple and economical method of improving the thermal performance of heat exchangers. The use of such a technique results in a reduced surface area requirement and consequently a smaller heat exchanger and reduced equipment cost. The augmentation of the heat transfer by inserting different type turbulators (Yakut et al. [2], Promvongse [3]) into the channels is the conventional passive enhancement method. The wire coil insert is one of the common heat transfer devices. These tube inserts enhance the convective heat transfer by interrupting the boundary layer development and raising the degree of turbulence or by increasing the heat transfer area or by generating the swirl flow. Garcia et al. [4] experimentally studied the thermohydraulic behavior of a round tube with helical-wire coil inserts in laminar, transition and turbulent regimes at different Prandtl numbers. In the investigation, they used water and water-propylene glycol mixtures (R_3) as the test fluid at different temperatures. The authors tested six wire coils within a geometrical range of helical pitch $1.17 < p/d < 2.68$ and wire diameter $0.07 < e/d < 0.10$. They showed that within the transition region, by fitting the wire coils

inside a smooth tube heat exchanger, the heat transfer rate increased upto 200%. Naphon [5] presented the heat transfer characteristics and pressure drop results of horizontal concentric tubes with coil-wire insert. They initiated that the coil-wire insert had significant effect on the enhancement of heat transfer especially on laminar flow region and showed that the heat transfer enhancement decreased with the increase of Reynolds number. An experimental investigation had been carried out by Behabadi et al. [6] to study the heat transfer augmentation and pressure drop by wire coil inserts at the time of heating the engine oil inside a horizontal tube. They developed two empirical correlations within an error band of $\pm 20\%$. Gunes et al. [7] experimentally investigated the heat transfer and pressure drop in a tube with coiled wire inserts placed separately from the tube wall in turbulent flow regime. Where they used three different pitch ratio of the wire coil insert. An experimental study in a coiled wire inserted tube in turbulent flow regime was carried out by Gunes et al. [8]. They used equilateral triangle cross sectioned wire coil inserts and showed that low Reynolds number regime were the best operating regime for wire coil insert. Bhuiya et al. [9] conducted an experimental study to

investigate the heat transfer enhancement for turbulent flow in a tube by means of triple tape inserts.

2. EXPERIMENTAL SETUP

The experimental apparatus, shown in Fig. 1 consists of a heated test section, air and power supply system, instrumentation to measure flow rate and temperature. The tube was a smooth circular tube made of copper ($k_c=379 \text{ W/mK}$) having 27 mm inside diameter, 30 mm outside diameter and 305 mm long, of which length of 285 mm was used as the test section. The wire coil insert used in the experiment was fabricated by bending a 2.8 mm diameter stainless steel wire into a coil of which the dimensionless wire diameter (e/d_i) was 0.11 and dimensionless pitch (p_i/d_i) was 0.71. Figure 2 shows the schematic diagram of a wire coil insert and fig. 3 shows the photograph of the wire coil insert. To measure the surface temperature of the tube wall, six K-type thermocouples were used, which were placed 40 mm apart from each other and the distance of thermocouple from the entrance and exit part of the test section were about 25 mm. In order to prevent the heat flow in the longitudinal direction and to prevent leakage of air from the upstream and downstream, Teflon disks (density = 2150 kg/m^3 , $k = 0.35 \text{ W/mK}$) had been used as the joining of tube in such a manner so that upstream and downstream tubes were fully thermally insulated/separated from the test section. The plain tube was

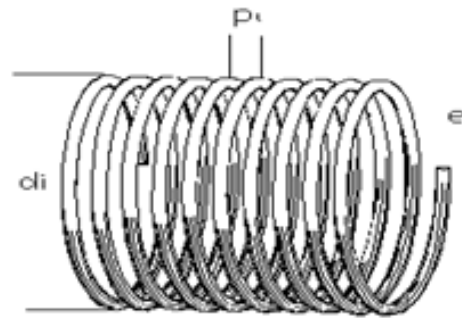


Fig.2 Sketch of a helical wire coil fitted inside a smooth tube.

linearly along the length of the test section. To break the boundary layer and to measure the mixing fluid temperature at the outlet section, a tee joint was adjusted at the end of the outlet section, of which one branch is closed by inserting a wooden block and at the outlet section the thermometer was placed at the other branch, 90° bend of the tee joint. And that part was open to the environment. So when flow came out through the downstream section, the boundary layers of the fluid flow broke at 90° bend of the tee joint and fully mixed with the wall of the tube. An inclined manometer was used the test section to measure the air pressure drop.

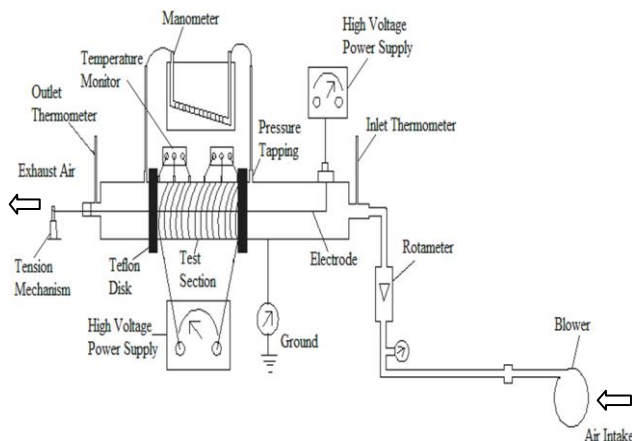


Fig.1 Schematic diagram of experimental setup.

covered with mica tape in two layers to electrically isolate the tube. A layer of glass fiber was put on the mica sheet. Nichrome wire (of resistance 31 ohm) used as an electric heater was spirally wound uniformly on the outer surface of the test section with spacing of approximately 2 mm. Then again mica sheet, glass fiber, teflon tape and heat insulating tape were sequentially put over the nichrome wire heater coil. The heating wire was connected to 220 Volt main. These protected the radial heat losses and also worked as an electrical insulation. The inlet and outlet air temperatures of test section were measured using thermometers inserted in the small holes made in the inlet and outlet of the test section and sealed to prevent any leakage. As the heat was added uniformly, the bulk temperature T_b of the fluid was assumed to vary



Fig.3: Photograph of the wire coil insert

Two pressure taps were drilled at 365 mm intervals across the test section with the first tap position 40 cm downstream from the inlet of the test section and the other was placed at 40 cm upstream from the outlet of the test section. An air flowmeter was used to measure the volumetric flow rate of the experiment. Its measuring range was 100-500 NL/min. The air supply was done by a blower. The blower was both suction and discharge type. The speed range of the blower was 0-16000 rpm. The maximum flow range of the blower was $3 \text{ m}^3/\text{min}$. The blower speed was controlled by a regulator provided in the system. It was powered by 220 Volt AC supply. After switching on the heating power; sufficient time was given to attain the steady state condition. In each run, data were taken for air flow rate, inlet temperature, outlet temperature and tube outer surface temperatures, pressure drop.

3. DATA REDUCTION

The measured data were reduced using the following procedure:
The heat transfer rate by the heater to air was calculated

by measuring heat added to the air. Heat added to air was calculated by,

$$Q = mC_p (T_o - T_i) \quad (1)$$

Heat transfer coefficient was calculated from,

$$h = Q / A (T_{wi} - T_b) = q / (T_{wi} - T_b) \quad (2)$$

where,

$$A = \pi d_i L \quad (3)$$

The bulk temperature was obtained from the average of air inlet and outlet temperatures,

$$T_b = (T_i + T_o) / 2 \quad (4)$$

Tube inner surface temperature was calculated from one dimensional radial conduction equation,

$$T_{wi} = T_{wo} - Q \cdot \frac{\ln(d_o/d_i)}{2\pi k L} \quad (5)$$

Tube outer surface temperature was calculated from the average of six local tube outer surface temperatures,

$$T_{wo} = \frac{1}{6} \sum_{i=1}^6 T_{wo,i} \quad (6)$$

Theoretical Nusselt number was calculated from Gnielinski [1] correlation and 'f' from Petukhov [10] relation.

$$Nu_{th} = \frac{(f/8)(Re-1000)Pr}{1 + 12.7(f/8)^{1/2}(Pr^{2/3}-1)} \quad (7)$$

where,

$$f = (0.79 \ln Re - 1.64)^{-2} \quad (8)$$

$$3000 \leq Re \leq 5 \times 10^6$$

$$Re = \rho V d_i / \mu \quad (9)$$

$$Pr = \mu C_p / k \quad (10)$$

$$Nu = h d_i / k \quad (11)$$

Pressure drop across the test section, is given as:

$$\Delta P = P_i - P \quad (12)$$

Here fiction factor, f can be calculated from

$$f = \frac{\Delta P}{(L/d_i)(\rho V^2/2)} \quad (13)$$

Pumping power, P_m can be defined as

$$P_m = \frac{\Delta P \times m}{\rho} \quad (14)$$

At constant pumping power the heat transfer enhancement efficiency,

$$\eta = \left| \frac{Nu_i}{Nu_p} \right|_{PP} \quad (15)$$

The proposed correlation for heat transfer enhancement efficiency with insert,

$$Nu_{prd} = C_7 Re^{m7} Pr^{n7} (e/d_i)^{x7} (p/d_i)^{y7} \quad (16)$$

4. RESULTS AND DISCUSSION

Before undertaking the experiments using the tube equipped with tube inserts, the heat transfer data were taken in a plain tube. In order to evaluate the validity of

the set up, the plain tube experimental data were compared with Gnielinski [1] correlation. Fig. 4 shows that the experimental data of Nusselt number for smooth tube fall within the range of $\pm 20\%$ of the Gnielinski [1] value with the r.m.s value of error 16.5%. Salam et al. [11] compared experimental Nusselt number for smooth tube with those calculated from Gnielinski [1] correlation and error were found within -24.7% and -5.6% with r.m.s value of error 20.3%. Salam et al. [12] found the error within -13% and +18% with r.m.s value of error 12% when they compared the data with Dittus and Boelter [13]. The developed correlations for the smooth tube are given as follow:

$$Nu_p = 0.000449 Re^{1.1943} Pr^{-0.4} \quad (17)$$

$$f_p = 152 Re^{-0.94899} \quad (18)$$

Nusselt numbers for the plain tube and the tube with wire coil insert are shown in fig 5. It is seen that, Nusselt number increased with the increase of Reynolds number

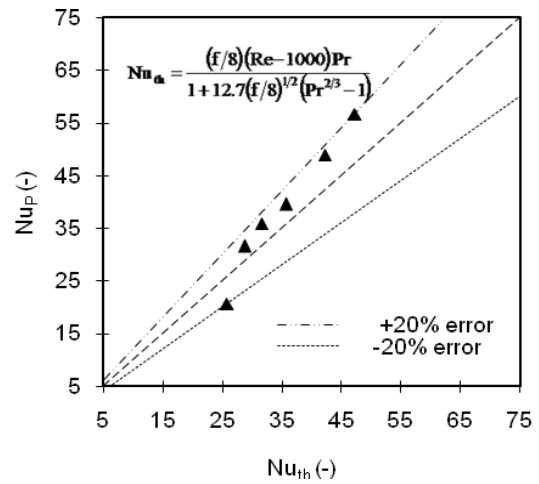


Fig.4: Comparison between experimental and theoretical Nusselt number.

and wire coil insert gave higher values of Nusselt number than those for plain tube. Reynolds number was calculated based on inner diameter of the tube. For plain tube Nu_p increased from 20.65 to 56.68 with the increase

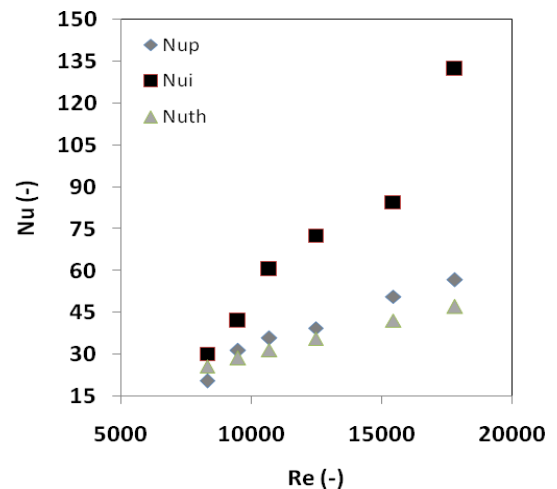


Fig. 5 The variation of Nusselt number with Reynolds number

of Reynolds number from 8317 to 17821. For tube with insert Nusselt number Nu_i increased from 30.29 to 132.19 with the increase of Reynolds number from 8317 to 17821. Therefore, at comparable Reynolds numbers, Nusselt number for tube with wire coil insert varied from 1.467 to 2.33 folds in comparison to the plain tube. The characteristics of the fig.5 are similar to the experimental result of Garcia et al. [4]. Figure 6 shows the heat flux variation for plain tube and tube with wire coil insert. It is seen that, heat fluxes increased with the increase of Reynolds number and insert gave higher heat flux than those for plain tube. The insert contributed to continuous interruption of the development of boundary layer as well as to generate the secondary flow and increased mixing resulting in higher heat transfer coefficients as

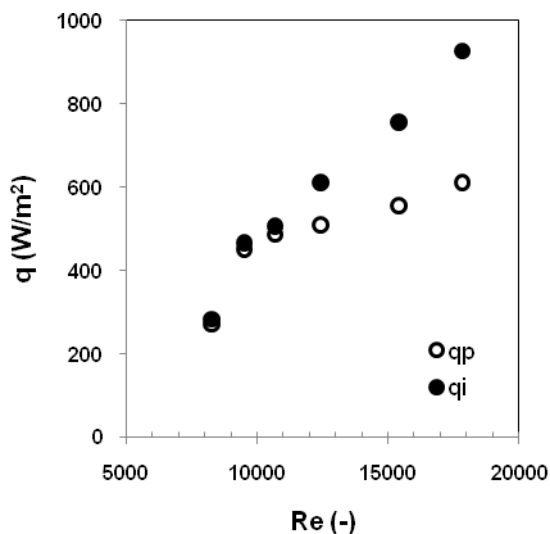


Fig. 6 The variation of heat flux with Reynolds number .

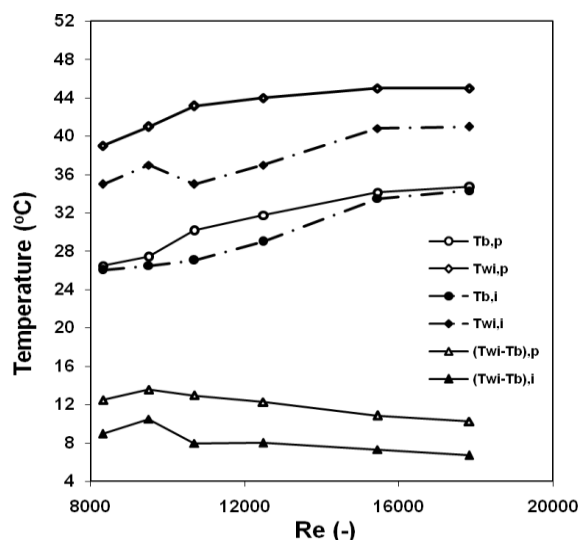


Fig. 7 The variation of temperature with Reynolds number

compared to the tube without insert. In fig. 7 the comparison of different temperature for insert has been shown. The temperature difference between wall and bulk fluid significantly decreased for tube with insert, fig. 8. Figure 8 also shows the variation in temperature

difference (wall and bulk) for plain tube and the tube with wire coil insert. From the fig. 7 and fig. 8 it is clear that the plain tube has the highest temperature difference. Keeping the other parameters fixed, the

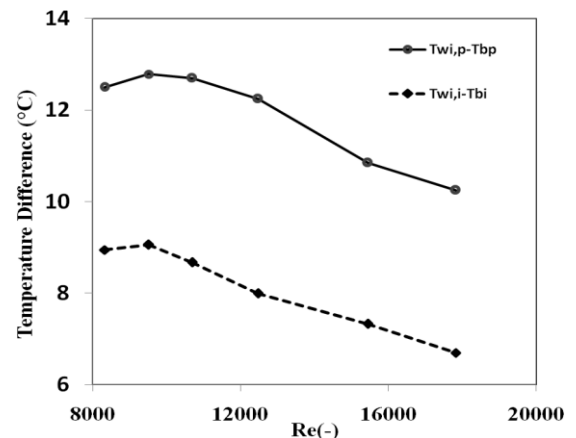


Fig. 8 Reynolds number vs. Temperature difference

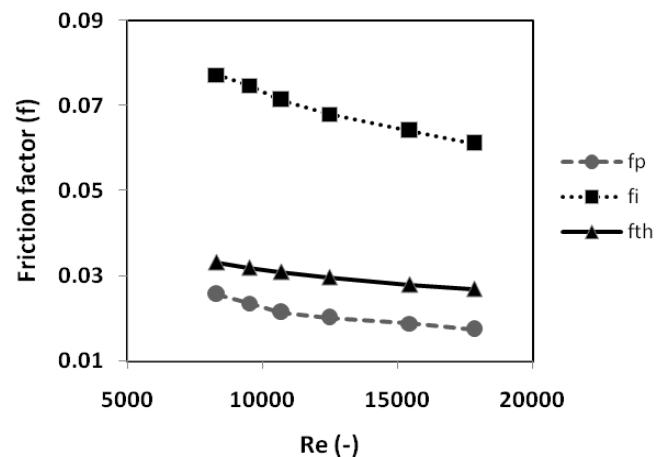


Fig. 9 The variation of friction factor with Reynolds Number

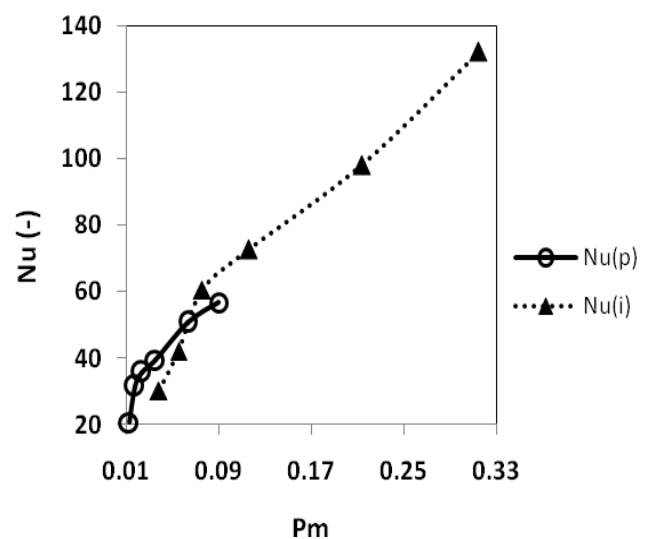


Fig.10 Nusselt number vs. pumping power for with and without insert.

smallest temperature difference indicates the highest heat transfer coefficient as heat transfer rate per unit area is assumed constant through the test section. The blockage of the flow due to the presence of the insert increases the flow velocity and improves the mixing of the flow (Bhuiya et al. [9]). So, the temperature difference for the insert was lower than that of the plain tube. In this case, considerable circumferential temperature difference was determined at the tube wall, which indicated that the flow was affected by the buoyancy forces (Garcia et al. [4]). Average of 52% enhancement of heat flux was observed for tube with insert than that of plain tube. The fig. 9 shows that, the friction factor tends to decrease with the increasing Reynolds number. In this experimental study, it is observed that the friction factor for tube with wire coil insert varies from 2.99 to 3.5 times than that of the plain tube at comparable Reynolds numbers. The presence of small vortices behind the insert may be responsible for increase of the friction factor. For the tube with insert pumping power increased as the Nusselt number increases. From the fig.10, it can be noted that the required pumping power at comparable Nusselt number for the tube with wire coil insert is very much higher than that of the plain tube. The pumping power required for the tube with wire coil insert varies from 2.99 to 3.46 times compared to that of the plain tube. From the fig. 11 it is observed

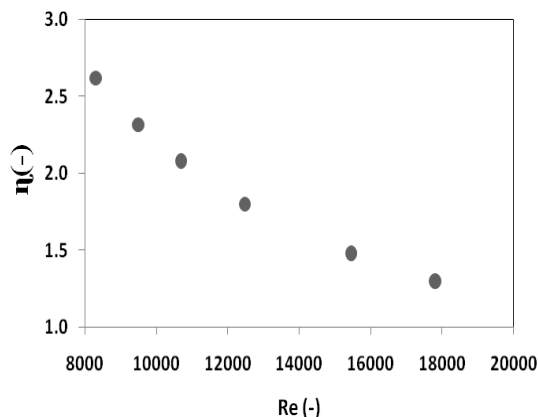


Fig.11 Variation of heat transfer enhancement efficiency with Reynolds number for wire coil insert

that the heat transfer enhancement efficiency increase provided by wire coil insert is remarkable and tends to decrease with the increase of Reynolds number. Heat transfer enhancement efficiencies were found to be in the range of 2.6 to 1.3 and decreased with the increase of Reynolds number. The result was as same as Gunes et al. [7],[8] and Garcia et al. [4]. A considerable heat transfer enhancement efficiency 1.27-2.5 was presented by Gunes et al. [7] by using wire coil insert.

Based on the current data, the tube side heat transfer coefficient was proposed in terms of the Nusselt number. The Correlation was of the form:

$$Nu_{prd} = 4084.5437 \cdot Re^{-0.927} \cdot Pr^{0.95} \cdot (e/d_i)^{-0.43} \cdot (p_i/d_i)^{-1.17506} \quad (19)$$

5. CONCLUSION

An experimental study was carried out to investigate the tube side heat transfer coefficient of air for turbulent flow in a circular tube fitted with wire coil insert. The results can be summarized as follows:

- The Nusselt number and heat flux increased with increasing Reynolds number. The Nusselt number for tube with wire coil insert varied from 1.467 to 2.33 folds in comparison to the plain tube.
- At equal Reynolds number the heat transfer coefficient for tube with wire coil insert increased from 1.5 to 2.3 times compared to that of plain tube.
- The experimental Nusselt numbers for smooth tube fell within $\pm 20\%$ of Gnielinski [1] value.
- The friction factor for tubes with wire coil insert varied from 2.99 to 3.5 times than that of the plain tube at comparable Reynolds numbers.
- At constant pumping power, the heat transfer enhancement efficiencies were found to be in the range of 2.6 to 1.3 and decreased with the increase of Reynolds number.

7. REFERENCES

- [1] V. Gnielinski, "New equation for heat and mass transfer in turbulent pipe channel flow", *Int. Chemical Engineering*, 16(2), pp. 359-368, 1976.
- [2] K. Yakut and B. Sahin, "The effects of vortex characteristics on performance of coiled wire turbulators used for heat transfer augmentation", *Applied Thermal Engineering*, vol. 24, pp. 2427-2438, 2004.
- [3] P. Promvong, "Thermal augmentation in circular tube with twisted tape and wire coil turbulators", *Energy Conversion and Management*, vol. 49, pp. 2949-2955, 2008.
- [4] A. Garcia, P. G. Vicente and A. Viedma, "Experimental study of heat transfer enhancement with wire coil inserts in laminar-transition-turbulent regimes at different Prandtl numbers", *Int. J. of Heat and Mass Transfer*, 48, pp. 4640-4651, 2005.
- [5] P. Naphon, "Effect of coil-wire insert on heat transfer enhancement and pressure drop of the horizontal concentric tubes", *International Communication in Heat and Mass Transfer*, 33, pp. 753-763, 2006.
- [6] A. Behabadi, M. A., Kumar, R., Salimpour, M. R. and Azimi, R., Pressure drop and heat transfer augmentation due to coiled wire inserts during laminar flow of oil inside horizontal tube, *Int. J. of Thermal Sciences*, 49, pp. 373-379, 2010

- [7] S. Gunes, V. Ozceyhan and O. Buyukalaca, "Heat transfer enhancement in a tube with equilateral triangle cross sectioned coiled wire inserts", *Experimental Thermal and Fluid Science*, 34, pp. 684-691, 2010a.
- [8] S. Gunes, V. Ozceyhan and O. Buyukalaca., "The experimental investigation of heat transfer and pressure drop in atube with coiled wire inserts placed separately from tube wall", *Applied Thermal Engineering*, 30, pp. 1719-1725, 2010b.
- [9] M. M. K. Bhuiya, J. U. Ahmed, M. S. U. Chowdhury, M. A. R. Sarkar, B. Salam, R. Saidur, H. H. Masjuki and M. A. Kamal, "Heat transfer enhancement and development of correlation for turbulent flow through a tube with triple helical tape inserts", *Int. Communications in Heat and Mass Transfer*, vol. 39, pp. 94-101, 2012.
- [10] B. S. Petukhov, in T. F. Irvine and I. P. Hartnett, Eds., *Advances in Heat Transfer*, vol. 6, Academic Press, New York, 1970.
- [11] B. Salam, S. Biswas, S. Saha, and M. M. K., Bhuiya, "Heat transfer enhancement in a tube using rectangular cut twisted tape insert", *Proc. The 5th BSME Int. Conference on Thermal Engineering*, 56, PP. 835-838, 2013.
- [12] B. Salam, S. Biswas and M. M. K., Bhuiya, "Heat transfer enhancement in a tube using twisted tape insert", *Proc. The 13th Asian Congress of Fluid mechanics*, Dhaka- Bangladesh, 835-838, 2010.
- [13] F. W. Dittus and L. M. K. Boelter, University Calif. (Berkely) Pub. Eng. vol. 2, p. 443, 1930.

8. NOMENCLATURE

Symbol	Meaning	Unit
A	Area of the heated region of tube	(m ²)
C_p	Specific heat of air at constant pressure	(J/kg.K)
d_i	Tube inner diameter	(m)
d_o	Tube outer diameter	(m)
e	wire diameter	(mm)
f	Friction factor	(-)
h	Heat transfer coefficient	(W/m ² .K)
k	Thermal conductivity of air	(W/m.K)
k_c	Thermal conductivity of tube material	(W/m.K)
L	Effective tube length	(m)
m	Mass flow rate of air	(kg/s)
Nu_i	Experimental Nusselt number with insert	(-)
Nu_p	Experimental Nusselt number for smooth tube	(-)
Nu_{prd}	Predicted Nusselt number	(-)

Nu_{th}	Theoretical Nusselt number from Gnielinski [1] correlation	(-)
Pr	Prandtl number	(-)
Q	Heat transfer rate	(W)
q	Heat flux	(W/m ²)
q_i	Heat flux for tube with insert	(W/m ²)
q_p	Heat flux for smooth tube	(W/m ²)
p_l	pitch	(mm)
P_i	Inlet pressure	(N/m ²)
P_o	Outlet pressure	(N/m ²)
Pm	Pumping power	(W)
ΔP	Pressure drop	(N/m ²)
\dot{Q}	Volume flow rate	(m ³ /s)
Re	Reynolds number	(-)
T_b	Bulk temperature	(°C)
$T_{b,i}$	Bulk temperature with insert	(°C)
$T_{b,p}$	Bulk temperature for smooth tube	(°C)
T_i	Air inlet temperature	(°C)
T_o	Air outlet temperature	(°C)
T_{wi}	Tube inner surface temperature	(°C)
$T_{wi,i}$	Tube inner surface temperature with insert	(°C)
$T_{wi,p}$	Tube inner surface temperature for smooth tube	(°C)
T_{wo}	Tube outer surface temperature	(°C)
$T_{wo,i}$	Tube outer surface temperature with insert	(°C)
V	Mean velocity	(m/s)
ρ	Density of air	(kg/m ³)
μ	Dynamic viscosity of air	(kg/m.s)
η	Heat transfer enhancement efficiency	(-)